


TYPICAL SIDEWALK with UTILITY STRIP

SUBGRADE

SUBGRADE

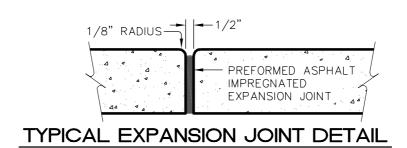

NOTES:

* VARIES, MAXIMUM SLOPE 3:1 UNLESS APPROVED BY THE

TOWN ENGINEER.

- 1. Provide 1" deep tooled traverse structural score joint with 1/8" radius at 5'-0" o.c.
- 2. 1/2" preformed asphalt impregnated expansion strip joints to be placed 40'-0" o.c. longitudinally, adjacent to curbs, when butting existing structures, concrete, or buildings, and at changes in width.



TOWN of CLAYTON

USE WITH THE TOWN of CLAYTON STANDARD SPECIFICATIONS ONLY

TYPICAL CONCRETE SIDEWALK AND EXPANSION JOINT DETAIL

SCALE: DETAIL #

Not To Scale 2 404.03

EVISION DATE: SHEET #:

REVISION DATE: SHE July, 2010 1